

# TANK SAFETY & PROTECTION DEVICES





# COMPANY OVERVIEW

Since its foundation in 1991 at Republic of Korea, **KSPC** has been developing industrial valves. Appointed as the Domestic-Product Development Enterprise for Tank Safety Valve, KSPC produces safety devices for flammable and nonflammable storage tanks by focusing on industrial valves.

Since then, KSPC's own Research Institute of Technology was established and its FMRC factory was approved in 1996, which serves as a momentum for KSPC to gain recognition on its product reliability and competitiveness. Supplying high-quality systems optimized for various fields such as petrochemical refinery, chemical treatment plant and natural gas supply line, KSPC also guarantees the maintenance of systems after delivery.

Through continuous research and development, KSPC has won many domestic and overseas certifications and patents, such as ATEX certification, ISO9001, ISO 14001, KFI, achieving recognition on the performance of its products. Having established quality goals that meets the requirements of ISO, KSPC concentrates on the improvement of its effectiveness and efficiency, standardizes process quality control, employees experts and enhances company-wide quality education for achieving systematic quality control.



# KSPC

# K.S.P.C VISION & MOTTO

VISION **1** Safety is the first and most important. **2** Think about Environment

MOTTO Truly think and consider customers. Truly make eco-friendly products. Truly think safe world

## QUICK ACCESS TO ITEM CATALOGS IN QR CODES

PRESSURE VACUUM RELIEF VALVE .....



FLAME ARRESTER .....



EMERGENCY RELIEF VALVE .....



GAUGE HATCH COVER .....




NITROGEN BLANKETING VALVE .....



Quick access to KSPC website in QR code .....  
[www.ikspc.com](http://www.ikspc.com)



Quick access to valve operating video  
in QR code .....

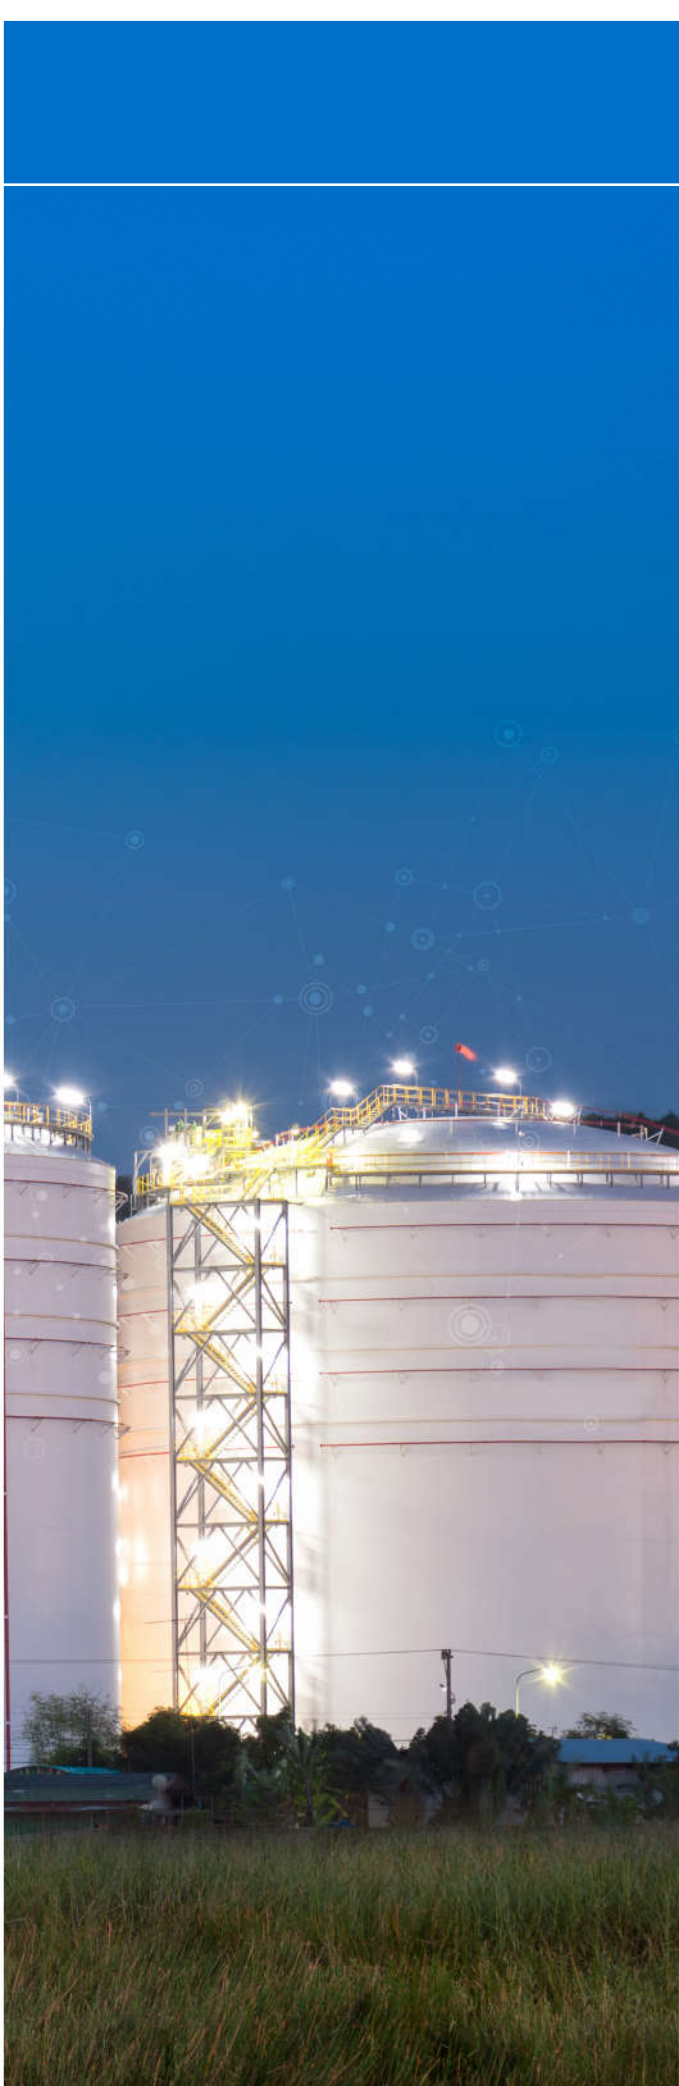





## CONTENTS

	Pressure vacuum relief Valve .....	05
	Valve operation & sizing calculation .....	06
	Flame arrester .....	10
	Flame arrester operation & selection .....	11
	Emergency relief valve .....	14
	Emergency relief valve operation & calculation .....	15
	Nitrogen blanketing valve .....	17
	Gauge hatch cover / Slot dipping devices / Air release valve .....	18
	Rupture disc .....	19



# PRESSURE VACUUM RELIEF VALVE



Model | KSBB/BS type



Disc Assembly



Internal Structure

❖ **Pressure Vacuum Relief Valve** is designed to protect low pressure storage tanks from excessive pressure or vacuum created by thermal expansion (and contraction) and product movement into(out of) the tank and at the same time minimizing costly product evaporation/loss.

SETTING PRESSURE	WEIGHT LOADED MODEL	±20 mmW.C ~ +700/-430 mmW.C
	SPRING LOADED MODEL	+700/-430 mmW.C~ ±9,000 mmW.C
SIZE RANGE	DN 50 ~ DN 350 with ASME 150# flanges (different connections available on request)	
BODY MATERIAL	Aluminum, Carbon Steel, 304 Stainless Steel and 316 Stainless Steel with various trims (different materials available on request)	
RULES & CERT.	API 2000, ATEX	




# VALVE OPERATION & SIZING CALCULATION

## A. VALVE OPERATION


According to API 2000 code, the **Pressure vacuum relief valve** are designed, manufactured and tested. The Pressure Vacuum Relief Valves are used on liquid storage Tanks which designed by API 520/API 650 and Others process vessels or systems to prevent structural damage due to excess internal pressure or vacuum.

This valve has functions to intake the air under constant pressure during unloading and rising Temperature, and to discharge the overpressure generated during pouring the liquid and falling Temperature on storage tank. This is the safe valve to control the deflation(vacuum) and inflation(pressure) of several storage tanks.




The function of prevention of natural evaporation of fluids

**THE EFFECT OF ENERGY REDUCTION** In case of gasoline, to minimize the natural evaporation of stores saves 98m<sup>3</sup> per year. (Based on the tank diameter: 30.4m x tank capacity 8690m)



The function of protection of over-pressure

**THE EFFECT OF PREVENTION OF EXPLORATION** With the exception of influx and efflux of stores, it is kept always closed to prevent the diffusion of exploration into tank.



The function of protection of under pressure

**THE EFFECT OF PREVENTION OF CORROSION** (The effect of extension of life). To keep the stabilization of constant gas pressure generated inside tank, prevents inside of the tank from corr-osion by the temperature of gas.

**WHEN TANK IS UNLOADING PHENOMENA AND THE PRESSURE** is above the setting(operational fixing pressure), the Pressure Vacuum Relief Valves operates automatically to protect the storage tank from the deflation or malformation.

The weight loaded type models are designed to provide tank protections for both pressure and/or vacuum of set point to max 75/-43 mbarg.

Over 75/-43 mbarg set point till 900/-900 mbarg, consider to be installed spring loaded type. Safety relief valve is not used in controlling the extra setting of pressure and consider Emergency vent for External fire and Rupture case.

The set point of Pressure vacuum relief valve is fixed by the customer's order or Project's Specification. but it is designed to adjust the pressure / vacuum setting in case. The way of change adds additional counter weight for Weight loaded type. The way of change for spring loaded as follow,

To increase the setting pressure turns the press. adjusting screw clockwise. To decrease the setting pressure turns the press. adjusting screw counter-clockwise. Before change set point of disc Assy, should be consulting the factory or our local representative.



Loading condition



Unloading condition



## B. VALVE SIZING CALCULATION

○ Required Inbreathing and Out-breathing capacity for your applications should be determined by using API2000 standard.

**B-1 Total Out-breathing caused by liquid movement and vaporization**  
 - Liquid movement (section 3.3.2.2.1 in API 2000 7th)

$$\dot{V}_{op} = \dot{V}_{pf}$$

$\dot{V}_{op}$  : Out-breathing volumetric flow rate (Nm<sup>3</sup>/h of air) at the actual pressure and temperature conditions of the tank vapor space with a vapour pressure equal to or less than 5.0 kPa.

$\dot{V}_{pf}$  : Maximum volumetric filling rate (Nm<sup>3</sup>/h) of nonvolatile liquids.

$$\dot{V}_{op} = 2.0 \cdot \dot{V}_{pf}$$

$\dot{V}_{op}$  : Out-breathing volumetric flow rate (Nm<sup>3</sup>/h of air) at the actual pressure and temperature conditions of the tank vapor space with a vapour pressure greater than 5.0 kPa.

$\dot{V}_{pf}$  : Maximum volumetric filling rate (Nm<sup>3</sup>/h) of volatile liquids.

- Thermal effect (section 3.3.2.3.2 in API 2000 7th)

$$V_{OT} = Y \cdot V_{tk}^{0.9} \cdot R_i$$

Y : is a factor for the latitude.  
 (search for the number in the table. Refer API2000 3.3.2.3.2)

Latitude	Y-factor
Below 42°	0.32
Between 42° and 58°	0.25
Above 58°	0.2

$V_{tk}$  : is the tank volume. (m<sup>3</sup>)

$R_i$  : is the reduction factor for insulation.

$$R_{inp} = \frac{A_{inp}}{A_{tts}} \cdot R_{in} + \left(1 - \frac{A_{inp}}{A_{tts}}\right) R_{in} \frac{1}{1 + \frac{h \cdot l_{in}}{\lambda_{in}}}$$

There are three cases in getting  $R_i$ .

No. insulation :  $R_i=1$

Fully insulated :

- $h$  : The inside heat-transfer coefficient (W/m<sup>2</sup>·K)
- $l_{in}$  : the wall thickness of the insulation (m)
- $\lambda_{in}$  : The thermal conductivity of the insulation (W/m·K)

3) Partially insulated

- $A_{tts}$  : The total tank surface area (shell and roof) (m<sup>2</sup>)
- $A_{inp}$  : The insulated surface area of the tank (m<sup>2</sup>)

**B-2 Total In-breathing caused by liquid movement and vaporization**

- Liquid movement (section 3.3.2.2.1 in API 2000 7th)

$$V_{ip} = V_{pe}$$

$V_{pe}$  : Out-breathing volumetric flow rate (Nm<sup>3</sup>/h of air) at the actual pressure and temperature conditions of the tank vapor space with a vapour pressure equal to or less than 5.0 kPa.

$V_{ip}$  : Maximum volumetric filling rate (Nm<sup>3</sup>/h) of nonvolatile liquids.

- Thermal effect (section 3.3.2.3.2 in API 2000 7th)

$$\dot{V}_{it} = C \cdot V_{tk}^{0.7} \cdot R_i$$

C : is a factor that depends on vapour pressure, average storage temperature and latitude.

Latitude	C-factor for various conditions			
	Vapour pressure			
	Average storage temperature, °C			
	Hexane or similar		Higher than hexane, or unknown	
	<25	≥25	<25	≥25
Below 42°	4	6.5	6.5	6.5
Between 42° and 58°	3	5	5	5
Above 58°	2.5	4	4	4

$V_{tk}$  : is the tank volume. (m<sup>3</sup>)

$R_i$  : is the reduction factor for insulation. The way to calculate 'R<sub>i</sub>' is equivalent to the method which is in the upper part of this page.

○ The size of the valve shall be selected by comparing our certified flow / pressure drop diagrams with calculated inbreathing and out breathing.

- Check point

- 1) Set pressure : The adjusted pressure or vacuum which valve start to open.
- 2) Over pressure : Pressure increase at the valve inlet above the set pressure or vacuum.
- 3) Over pressure calculation

- Example.1

- Valve set pressure = 50mm.W.C
- Tank Design pressure = 80mmW.C
- Max. allowable over pressure = 60% (80mmW.C = 1.6times of 50mmW.C)

- Example.2

- Valve set vacuum = -50mm.W.C
- Tank Design vacuum = -100mmW.C
- Max. allowable over pressure = 100% (-100mmW.C = 2times of -50mmW.C)

- 4) Size select comparing flow/pressure drop diagram with calculated inbreathing and out breathing

- Example (Check figure 01 & 02)

- Calculated Out breathing = 500Nm<sup>3</sup>/hr
- Valve set pressure = 80mmW.C
- Calculated Max. allowable over pressure = 60%




Figure 01

2" Valve flow capacity not enough to meet calculated Out breathing 500Nm<sup>3</sup>/hr




Figure 02

3" Valve flow capacity enough to meet calculated Out breathing 500Nm<sup>3</sup>/hr

- 5) According to API2000, The maximum overpressure shall be 2times of adjusted set pressure or vacuum. If the fully open position of the valve disc is not achieve at two times the adjusted valve set pressure, one step above size or additional measuring point(=additional valve) are required until the fully open position is reached to calculated in/out breathing.

\* Note : Direct-acting vent valve are typically available in size from 50mm to 350mm.



# **VENT TO ATMOSPHERE** www.kspc.com.vn **PRESSURE VACUUM RELIEF VALVE**

❖ Vent to ATM pressure vacuum relief valves are an advanced design for vent to atmosphere applications.

Designed manufactured and tested according to the API2000 code. It is a safety device made in response to the pressure and vacuum in the storage tank. Opening at accurate settings, it protects the tank from damages due to explosion and vacuum, minimizes the loss of product by preventing leakage of the tank and protects environment from poisonous gases.



Model | **KSPR type**

Pressure relief



Model | **KSPS type**

Pressure relief  
(Spring loaded type)



Model | **KSVR/VS type**

Vacuum relief



Model | **KSBB/BS type**

Pressure / vacuum relief



Model | **KSBBFI type**

Vent to ATM pressure /  
vacuum relief w /  
flame arrester



Model | **KSBBFH type**

Vent to ATM pressure /  
vacuum relief w /  
flame arrester



Model | **KSBBJ type**

Pressure vacuum relief w /  
steam jacket



Model | **KSBBFY type**

Pressure/  
vacuum relief w /  
dehumidifier



# **PIPE AWAY** **PRESSURE VACUUM RELIEF VALVE**

❖ Pipe away pressure vacuum relief valves are an advanced design for pipe away application.

Designed manufactured and tested according to the API2000 code. It is a safety device made in response to the pressure and vacuum in the storage tank. Opening at accurate settings, it protects the tank from damages due to explosion and vacuum, minimizes the loss of product by preventing leakage of the tank and protects environment from poisonous gases.



**Model | KSB type**

Pressure relief  
Vacuum relief



**Model | KSDS TYPE**

Pressure relief  
Vacuum relief  
(Spring loaded type)



**Model | KSBG/BS type**

Pressure / vacuum relief



**Model | KSBGFI type**

Pipe away pressure /  
vacuum relief w /  
flame arrester



**Model | KSBGFH type**

Pipe away pressure /  
vacuum relief w /  
flame arrester




**Model | KSPO type**


Pressure Vacuum Relief Valve (Pilot Operated)  
\*Advantage : Fully open at 10% over pressure.  
Leakage rate of 0.015% Nm<sup>3</sup>/hr  
or less at 90% of set point.



# FLAME ARRESTER

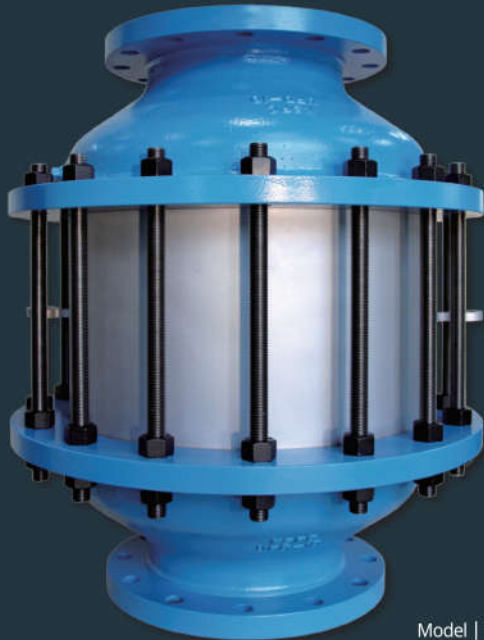

Model | KFD type

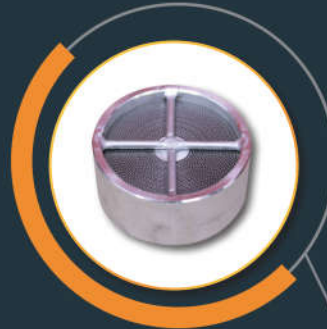

Element



Internal Structure

❖ **Flame Arrester** is used for preventing flame transmission when an explosion is occurred inside of the piping which full of explosive mixed gas

OPERATING TEMPERATURE @ PRESSURE	+60 °C @ 0.11 Mpa
SIZE RANGE	DN 50 ~ DN 1000 with ASME 150# flanges (different connections available on request)
BODY MATERIAL	Aluminum, Carbon Steel, 304 Stainless Steel and 316 Stainless Steel with various trims (different materials available on request)
RULES & CERT.	ISO 16852, ATEX



# FLAME ARRESTER OPERATION & SELECTION

Flame arresters are passive devices with no moving parts. Flame arresters prevent the propagation of flame from the exposed side of the unit to the protected side by the use of wound crimped metal ribbon type flame cell element(Figure 03). This construction produces a matrix of uniform openings that are carefully constructed to quench the flame by absorbing the heat of the flame. This provides an extinguishing barrier to the ignited vapour mixture. Under normal operating conditions the flame




Figure 03

arrester permits a relatively free flow of gas or vapour through the piping system. If the mixture is ignited and the flame begins to travel back through the piping, the arrester will prohibit the flame from moving back to the gas source.

## Flame arrester operation

When the combusted gas pass through the heat exchange lattace net of the element bank of the flame arrester in inline Flame arrester type, the combusted gas ignifed by the quenching is completely extinguished by lowering the temperature under below the natural ignition point. Thus, this item is designed to extinguish the fire automatically, and the heat is absorbed by the element bank of flame arrester and the fire cannot be spread.

## MESG (Maximum Experimental Safe Gap)

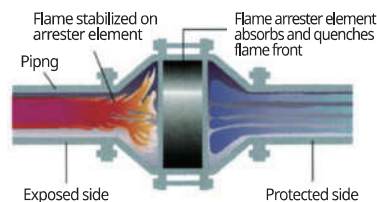

Measurement of the maximum gap between two equatorial flanges on a metal sphere that will prevent a flame from being transmitted from the sphere to the surrounding flammable mixture. MESG is dependent on gas composition, The stoichiometric mixture is used to determine the minimum MESG value for a given gas.

Range of application (marking)		Requirments for test mixture			
Explosion group	MESG of mixture mm	Gas type	Gas purity by volume %	Gas in air by volume <sup>2</sup> %	Safe gap of gas-air mixture mm
IIA1	≥1,14	Methane	≥98	8,4 ± 0,2	1,16 ± 0,02
IIA <sup>2</sup>	>0,90	Propane	≥95	4,2 ± 0,2	0,94 ± 0,02
IIB1 <sup>1</sup>	≥0,85	Ethylene	≥98	5,2 ± 0,2	0,83 ± 0,02
IIB2 <sup>2</sup>	≥0,75			5,7 ± 0,2	0,73 ± 0,02
IIB3 <sup>3</sup>	≥0,65			6,6 ± 0,3	0,67 ± 0,02
IIB <sup>4</sup>	≥0,50	Hydrogen	≥99	45,0 ± 0,6	1,16 ± 0,02
IIC	<0,50	Hydrogen	≥99	28,5 ± 2,0	1,16 ± 0,02

## Flame arrester selection

Flame propagation poses significant dangers to systems and personnel in industries worldwide. Careful consideration must be taken to determine whether to use a Flame Arrester or a Detonation Flame Arrester. There are two basic determinations when evaluating the intended application:

Q. The location of the ignition source from the flame arrester, and;

Q. What needs to be protected.

First, determine the location of all potential ignition sources (i.e. flare, vacuum pump, blower, burner, lightning strike, static discharge, etc).

Second, evaluate the system to determine exactly what should be protected (i.e., the gas source, process component, personnel, upstream process facility, tank, etc.).

When you have determined the ignition source(s) and what is to be protected, the following parameters should be evaluated in order to determine the appropriate flame arrestment protective device:

1. Length and configuration of pipe and pipe between ignition source and arrester.
2. System gas grouping.
3. Initial operating pressure.

## 4. Flame stabilisation on element.

All of these variables affect the performance of the arrester and can also affect the dynamics of flame propagation

### Inline and End of Line Applications

The inline flame arrester and the end of line (free vent) arrester are used to stop flame propagation of confined and unconfined low pressure deflagrations. They are typically used for limited piping applications when the system operating pressure is near atmospheric levels.

### Detonation application

The detonation flame arrester is an advanced technology flame arrester. They are used to stop the high pressures and velocities associated with detonation. They stop confined and unconfined low and high pressure deflagrations, stable and overdriven detonations. Application parameters for the detonation flame arresters far exceed those of flame arresters for pipe lengths, configurations, system operating pressures, and flame stabilization. Our flame arresters are designed, manufactured and tested according to BS7244. BSEN12874 and ISO16852 test standards and codes.

### System gas grouping

The type of gas in the system and it's corresponding gas group determines the design of the arrester element. The SS316L element must be designed to accommodate the specific gas group that could possibly ignite and propagate in the system. The available designs consist of International Electric Code (IEC) group gases into IIB,IIA and IIC, the National Electric Code (NEC) groups gases into A, B, C and D categories depending on the MESG value of the gas.

## GAS GROUP CHART

### Group A

Acetylene

### Group B(IIC)

Butadiene  
Ethylene oxide  
Hydrogen  
Manufactured gases containing more than 30% Hydrogen (by volume)  
Propylene oxide  
Propyl nitrate

### Group C (IIB3)

Acetaldehyde  
Cyclopropane  
Diethyl ether  
Dimethylhydrazine  
Ethylene  
Hydrogen sulfide  
Methyl mercoptan  
Unisymmetrical dimethyl hydrazine UDMN)

### Group D (IIA)

Acelone  
Acrylonitrile  
Ammonia  
Benzene  
Butylene  
1-Butanol (butyl alcohol)  
2-Butand (secondary butyl dcohol)  
Cyclohexane  
N Butyle ocetate  
sobutyl gcetate  
Ethone.ecohol  
Ethanol (ethyl alcohol)  
Ethyl acetate.  
Ethyl acrylate  
Ethylene dichloride  
Gasoline  
Heptanes  
Hexanes  
soprene  
Methane (natural gas)  
Methanol (methyl alcohol)  
Methyl acrylate  
Methylamine  
Methyl ethyl ketone  
Methyl mercoptan

### Group D (IIA)continued)

3-Methyl-1-butanol isoamyl alcohol)  
Methyl isobutylketone  
2-Methyl-1 propanol isobutyl ccohol)  
Methyl-2-propanol tertiary butyl alcohol  
Naphtha (petroleum)  
N Propyl acetate  
Octanes  
Pentanes  
1-Pentanol (amyl aloohol)  
Propane  
1-Propanol (propyl alcohol  
2-Propanol (isopropylalcohol  
Propylene  
Styrene  
Toluene  
Turpentine  
Vinylacetafe  
Vinyl chloride  
Xylenes

# ☒ DEFLAGRATION FLAME ARRESTERS

☒ Deflagration flame arrester is used for protect storage tank from deflagrations.



Model | **KSFI type**

Inline flame arrester  
Possible to install vertically  
and horizontally



Model | **KSFE type**

End line flame arrester  
Should be installed vertically



Model | **KSFH type**

Inline flame arrester  
Possible to install vertically  
and horizontally



Model | **KSFL type**

Inline flame arrester  
Should be Install horizontally



Model | **KSFIJ type**

Flame arrester w/  
steam jacket



Model | **KSFT type**

Inline flame trap



Model | **KSFI-A**

Inline flame arrester,  
possible to install vertically  
and horizontally



Model | **KSFE-S type**

End line flame arrester, Should  
be installed vertically



Model | **KSFE-A type**

End line flame arrester, Should  
be installed vertically





# **DETONATION FLAME ARRESTERS**

- ❖ Detonation flame arresters provide positive protection against flame propagation in piping systems that are manifolded or have long runs.

The arresters are designed to stop and ignited flammable vapour mixture travelling at subsonic or supersonic velocities.

They are also designed to protect against continuous burning against the 316LSS flame cell elements for a specific period



**Model | KFD type**

Inline flame arrester  
Possible to install vertically and horizontally



**Model | KSFLD type**

Inline flame arrester  
Should be installed horizontally



**Model | KSFD type**

Inline flame arrester  
Should be installed horizontally



**Model | KSFM type**

Inline flame arrester  
Should be installed right angle pipe line




**Model | KSFD-A type**

Inline detonation flame arrester,  
Possible to install vertically and horizontally



# EMERGENCY RELIEF VALVE

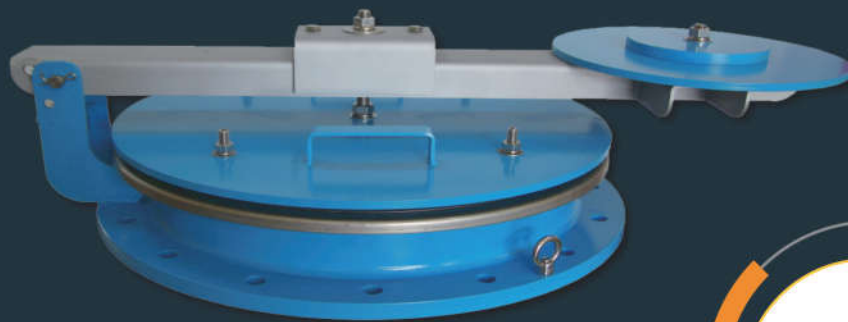

Model | KSEPK type



Disc Assembly



Self Closing

Emergency relief valve open to greatly increase the venting capacity of petroleum storage tanks when the internal pressure rises above the set point. It remains closed tightly when internal pressure below the settings.

SETTING PRESSURE	WEIGHT LOADED MODEL	+50 /-25 mmW.C ~ ±700 mmW.C
	SPRING LOADED MODEL	+700/-20 mmW.C ~ ±9,500/-700 mmW.C
SIZE RANGE	DN 400 ~ DN 750 with ASME 150# or API 650 flanges (different connections available on request)	
BODY MATERIAL	Aluminum, Carbon Steel, 304 Stainless Steel and 316 Stainless Steel with various trims (different materials available on request)	
RULES & CERT.	API 2000, ATEX	



# VALVE OPERATION & SIZING CALCULATION

## A. Valve operation

Emergency relief valve is the safety valve to protect the storage tank from the inflation (pressure) with the function to discharge rapidly the overpressure developed during external fire around the storage tank or the Excessive fluid intake more than the capacity of pump planned.

Emergency relief valve is designed to be Cushioned air seating, Teflon (PTFE/FEP-2 Layer) seating diaphragm are Standard. It minimize sticking caused by resinous vapors and atmospheric moisture. The Seat tightness is 75% of set point by API 2000. It is designed to be self dosing under normal operation by Internal Guide & external Hinge and the restraining cable to Connect the Cover assembly and Flanges also serve a grounding cable.



The Emergency relief valve provides pressure / or vacuum relief when the tank is loading phenomena and external fire or Rupture cases also the pressure is above the setting (Operational Fixing pressure), the Emergency relief valve operate automatically to protect the storage tank from inflation.

The weight loaded type model max. set point is 70/-43mbarg and spring loaded type is till 900/-900 mbarg.

## B. Valve Sizing

Where the fluid properties are similar to those of hexane, the required venting capacity can be determined as table 03.

If the height of the tank exceeds 9.14 meters, use the same number to the tank which is higher than 9.14 meters for calculation. If wetted surface area is wider than 260 m<sup>2</sup>, there are two cases. Refer to the following table 01.

Wetted surface area <i>A<sub>TWS</sub></i> , m <sup>2</sup>	Design pressure kPa (gauge)	Required Venting Calculation Nm <sup>3</sup> /h of air
<260	≤103.4	See table 03
>260	≤7	19910
≥260	>7 and ≤103.4	$q = 2082 \cdot F \cdot A_{TWS}^{0.82}$

Table 01

$$A_{TWS} = \pi \cdot D \cdot L \quad A_{TWS} = \pi \cdot D \cdot L \cdot 9.14$$

(In case of L < 9.14 meters)                      (In case of L > 9.14 meters)

Where the fluid properties are other than hexane, the required venting capacity can be calculated given by below equation.

$$q = 906.6 \cdot \frac{Q \cdot F}{L} \cdot \left(\frac{T}{M}\right)^{0.5}$$

*Q* is the heat input from fire exposure as given by Table 02, expressed in watts.

*F* is the environmental factor from table 09 (API 2000 Clause 3.3.3.3.2).

*L* is the latent heat of vaporization of the stored liquid at the relieving pressure and temperature, expressed in joules per kilogram.

*T* is the absolute temperature of the relieving vapor, expressed in kelvins

*M* is the relative molecular mass of the vapor

Wetted surface area <i>A<sub>TWS</sub></i> , m <sup>2</sup>	Design pressure kPa (gauge)	Heat Input, Q W
<18.6	≤103.4	63,150 <i>A<sub>TWS</sub></i>
≥18.6 and <93	≤103.4	224,200 * ( <i>A<sub>TWS</sub></i> ) <sup>0.566</sup>
≥93 and <260	≤103.4	630,400 * ( <i>A<sub>TWS</sub></i> ) <sup>0.388</sup>
≥260	>7 and ≤103.4	43,200 * ( <i>A<sub>TWS</sub></i> ) <sup>0.82</sup>
≥260	≤7	4,129,700

Table 02

Wetted area <sup>a</sup> (Square meters)	Venting Requirement (Nm <sup>3</sup> /h)	Wetted area <sup>a</sup> (Square meters)	Venting Requirement (Nm <sup>3</sup> /h)
2	608	35	8086
3	913	40	8721
4	1,217	45	9322
5	1,521	50	9895
6	1,825	60	10,971
7	2,130	70	11,971
8	2,434	80	12,911
9	2,738	90	13,801
11	3,347	110	15,461
13	3,955	130	15,751
15	4,563	150	16,532
17	5,172	175	17,416
19	5,780	200	18,220
22	6,217	230	19,102
25	6,684	260	19,910
30	7,411	>260 <sup>b</sup>	-

Table 03

The size of the valve shall be selected by comparing our certified flow / pressure drop diagrams with calculated inbreathing and out breathing.

**Check point.**

- 1) Set pressure : The adjusted pressure or vacuum which valve start to open.
- 2) Over pressure : Pressure increase at the valve inlet above the set pressure or vacuum.
- 3) Overpressure calculation

**Example**

- Valve set pressure = 100mm.W.C(90% or same as tank design pressure)

- Tank Design pressure = 100mm.W.C


· Max. allowable over pressure = 10%(Emergency relief valve set pressure is usually 90% or same as Tank design pressure hence max. allowable design pressure is 10% generally) Size select comparing flow/pressure drop diagram with calculated emergency out breathing.

**Example** (Check figure 01 & 02)


· Calculated Out breathing = 19,910m<sup>3</sup>/hr

· Valve set pressure = 100mm.W.C

www.Calculated Max. allowable over pressure = 10%



20" Valve flow capacity not enough to meet calculated Out breathing 19,910Nm<sup>3</sup>/hr



24" Valve flow capacity enough to meet calculated out breathing 19,910Nm<sup>3</sup>/hr



## WEIGHT LOADED TYPE



Model | KSEP type

Pressure relief



Model | KSEPK type

Pressure relief  
Hinged type  
- closed automatically



Model | KSEV type

Pressure / vacuum relief



Model | KSEVK type

Pressure / vacuum relief  
Hinged type  
- closed automatically



Model | KSEVJ type

Pressure /  
vacuum relief w /  
steam jacket



Model | KSEPW type

Pressure relief  
Water seal type  
- zero leakage at set point

## SPRING LOADED TYPE



Model | KSES type

Pressure relief



Model | KSESV type

Pressure / vacuum relief



# NITROGEN BLANKETING VALVE



Model | DST100/200 type

✦ **Nitrogen Blanketing Valve** helps gas pressure to maintain In constant state in the vapour space of storage tanks.

When liquid run out from storage tanks or vacuum state take place because of temperature dripping, N2 blanketing Valve has a ability of control desired pressure within the fixed limits.

Besides about subjects, prevents air and humidity from entering into storage tank, so it can preserve product, and also protect from a fire.

It protects the tank from explosion by restriction spark. It prevents the outflow of fluid by evaporation.

## • DIMENSION TABLE

SIZE	DST-100			DST-200	
	1/2"	3/4"	1"	1 1/2"	2"
N.D	15	20	25	40	50
A	290	290	290	340	340
Approx. H	365	365	365	450	450

NOTE Standard Connection(ANSI 150LB flange) and JIS or different types are available upon request.

## • GENERAL SPECIFICATION

MODEL	DST-100	DST-200
SIZE	1/2" ~ 1"	1" ~ 2"
SET PRESSURE	30 ~ 5000mmW.C	
CONNECTION	FNPT / ANSI 150# & 300#, Etc	
MATERIAL	SS304, SS316, Etc.	
USED GAS	N2 (Nitrogen)	
SENSING PORT	NPT 1/2"	

## • TECHNICAL SPECIFICATION

SET PRESSURE		MINIMUM INLET PRESSURE	TEMP.
1.2 ~ 1.4" W.C	1.3 ~ 3.1 psi		
3.5 ~ 10" W.C	2.3 ~ 3.5 psi		
8 ~ 18" W.C	3.0 ~ 6.0 psi		

## GAUGE HATCH COVER & SLOT DIPPING DEVICES



Model | KSGE type

Operating pressure  
- 0.01 kg/cm<sup>2</sup>



Model | KSGH type

Operating pressure  
- 0.03 kg/cm<sup>2</sup>



Model | KSSD-A type



Model | KSSD type



Model | T-2000-TSS-01 type

∴ **KSPC's Sampling and Gauging Hatch Cover** is designed to provide quick access for product gauging, temperature measurement or sampling.

∴ **KSSD Series Sampling Device** is designed for gauging the height of liquid levels, measuring the depth of water bottoms, taking temperature, and taking sample of liquids held in storage tank, without relieving pressure within the tank.

## VACUUM BREAKER & AIR RELEASE VALVE




Model | KSVBBJ type

∴ **Air release valve** is designed to release accumulated air pockets from the system, while pressured pipelines. Air pockets increase energy consumption because pumping operation will be at higher water heads to overcome pressured air. Air release valves are have function to protect high shock and surge pressure, water hammer and liquid overflow from fresh or sea water pipelines.



# RUPTURE DISC

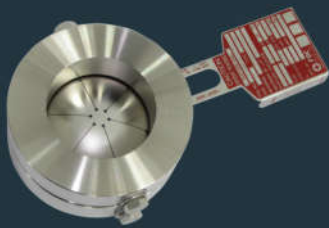

Rupture Disc holder and disc assembly



Rupture Disc



Explosion Panel

➤ **A Rupture Disc** is a non-mechanical safety device to relief when it is occurred that excessive pressure is over the critical pressure in a pressure system

• **When is it required a Rupture Disc?**

- In case of a rapid rise in pressure as a result of runaway reaction and so on
- In case that there is any concern that fixtures cause other safety device malfunction
- In case that any leakage is not permitted
- In case that it contains strong corrosive fluid
- In case that it requires large relieving capacity in an instant by polymerization and so on
- Severe conditions such as high or low temperature

• **Features**

- Special material and structure (It is easy to select material and is economical) And there is no size limit
- Constant rupture performance and release all of fluid
- Instantaneous release of maximum capacity
- Extensive service environment (strong corrosive fluid, temperature, liquid, gas, powder, etc.)
- Zero Leakage
- Extension of safety valve life
- Possible to check the Piping of outlet during operating
- Extension of overhaul period
- Easy to handle and cost reduction

• **Applicable Code**

- ASME Sec. VIII Div.1
- ISO 6718
- ISO 4126-2-6
- API RP520
- KOSHA Safety Certification

• **When is it required a Rupture Disc?**

- Stainless Steel (304SS, 316SS, 317SS, etc)
- Carbon Steel
- Duplex
- Aluminum
- Nickel, Inconel, Monel, Hastelloy, Titanium, Tantalum
- Graphite
- Teflon
- Maximum usable Temperature

Teflon	200 °C	Monel	483 °C
Aluminum	120 °C	Inconel	592 °C
Stainless Steel	483 °C	Hastelloy	483 °C
Nickel	403 °C	Graphite	371 °C

• **Application of Rupture Disc**

1) Primary Case



2) Secondary Case



3) Combination Case



4) External Fire Case







**Korea Steel Power Corp.**

### ❖ Tank Protection Devices

- Flame Arrester
- Breather Valves
- Air Release Valve
- Vacuum Breaker
- Pilot Operating Pressure / Vacuum Valves
- Emergency Relief Valve
- Gauge Hatches
- Sampling Dipping Devices
- Flame Trap Assembly
- Floating Suction
- Roof Drain System
- Oil Skimmer
- N2 Blanketing
- Rupture Disc

### ❖ Application Fields

- Offshore & Ocean Gas Plants
- Marine Tank Ships
- Cryogenic Gas Facilities
- Sea & Fresh Water Plant
- Tank Terminals
- Refinery Tank Farm
- Gas Plants
- Oil & Chemical Storage Tanks

Exclusive Distributor of KSPC in Vietnam



#### **PHUC MINH ENGINEERING COMPANY LIMITED**

Add: 92/38, No.12 St, Binh Hung Hoa Ward, Binh Tan Dist, HCM City

Tel: (+84-28) 3535-2125 Fax: (+84-28) 3535-0254

Email: [info@kspc.com.vn](mailto:info@kspc.com.vn) - [info@pm-e.vn](mailto:info@pm-e.vn)

Website: [www.kspc.com.vn](http://www.kspc.com.vn) - [www.pm-e.vn](http://www.pm-e.vn)